


LEVEL = - 2.00MT.

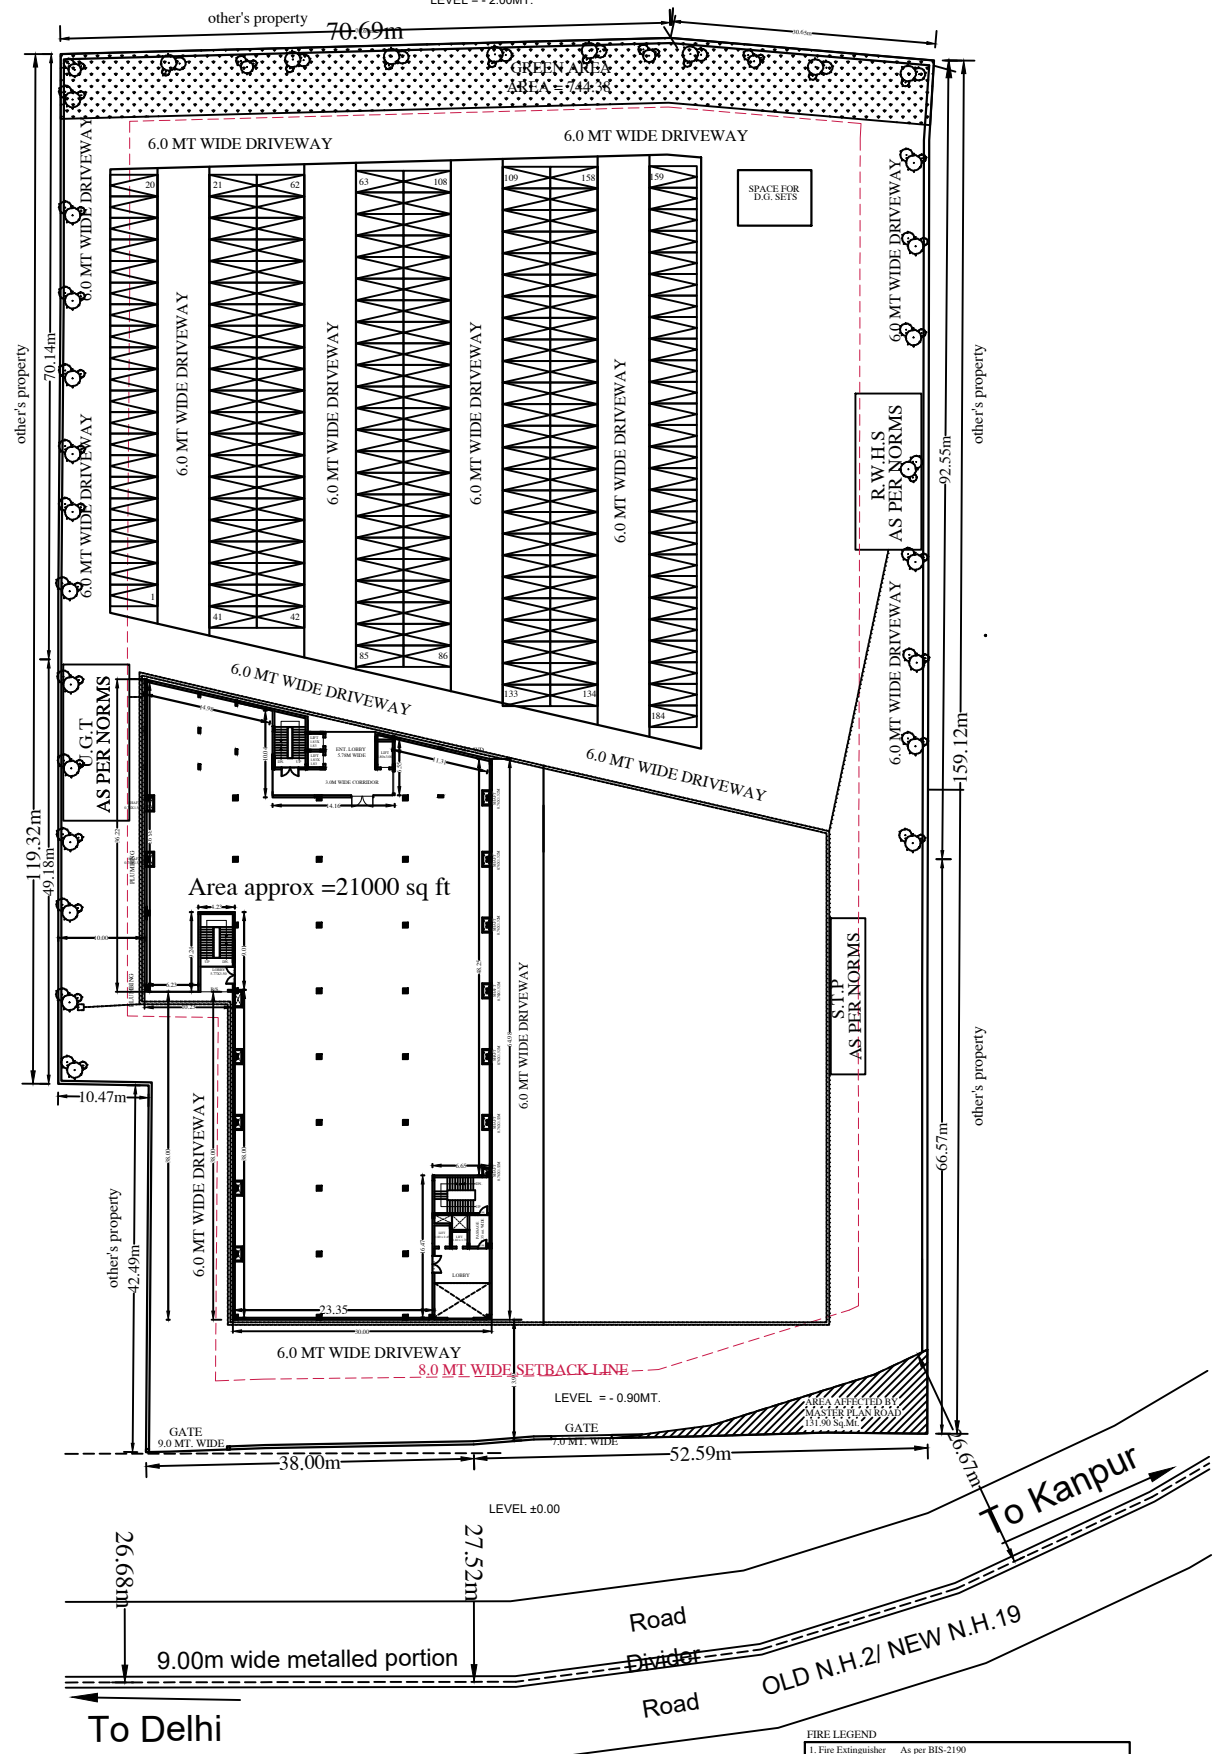

Area approx =21000 sq ft

GATE 9.0 MT WIDE

LEVEL = - 0.90MT.

LEVEL ±0.00

FIRE LEGEND

1. Fire Extinguisher As per BIS-2190
2. Hose Reel As per BIS-884:1985.
3. Wet Riser As per BIS-3844:1989
4. Yard Hydrant As per BIS-1303:1991
5. Automatic Sprinkler System As per BIS-9972:2002 M Jockey Pump-180 LPM
6. Manually Operated Electric Fire Alarm System as per NBC-2016.
7. Automatic Detection and Fire Alarm System As per BIS-2189:1999
8. Under Ground Tank 1,00,000 Litre.
9. Tank @ FIFTH FLOOR 10,000 Litre ALONGWITH PUMP OF 900 LPM
10. Pump Main Electric Pump-2280 LPM Diesel Pump-2280 LP

First FLOOR PLAN

PROPOSED COMMERCIAL BUILDING PLAN AT KHASRA No. 631, 632, 635 TO 639, MAUZA KAKRETHA MUSTKIL, AGRA.
 OWNER'S NAME:- SHRI INDER CHAND JAIN, SHRI KISHAN CHAND JAIN, SHRI RAJENDRA CHAND JAIN, SHRI RAKESH KUMAR JAIN

OWNER'S SIGN.

SCALE:- 1: 300



AADHARSHILA
 ARCHITECTS, INTERIOR DESIGNERS, VAASTU CONSULTANTS
 106/1, G. G. MEDICAL INSTT.
 BUILDING SANJAY PLACE
 AGRA-2 PH.NO. 4000820